



# Hetch Hetchy Regional Water System

Services of the San Francisco Public Utilities Commission

525 Golden Gate Ave.  
San Francisco, CA 94102  
(415) 554-3155  
sfpuc.gov

TO: SFPUC Wholesale Customers

FROM: Steven R. Ritchie, Assistant General Manager, Water

*Steven R. Ritchie*


DATE: April 14, 2026

RE: Water Supply Availability Update

This memo provides the water supply availability estimate for Water Year 2026 and the current hydrologic conditions.

The plots below show precipitation at Hetch Hetchy and snowpack in the upcountry watersheds through April 13, 2026. As the plots show, despite nearly median precipitation at Hetch Hetchy, snowpack in the upcountry watersheds is only 25% of April 1 median. However, early runoff in 2026 and carryover storage retained from 2025 have resulted in above average system storage conditions.

## Hetch Hetchy Precipitation as of April 13, 2026

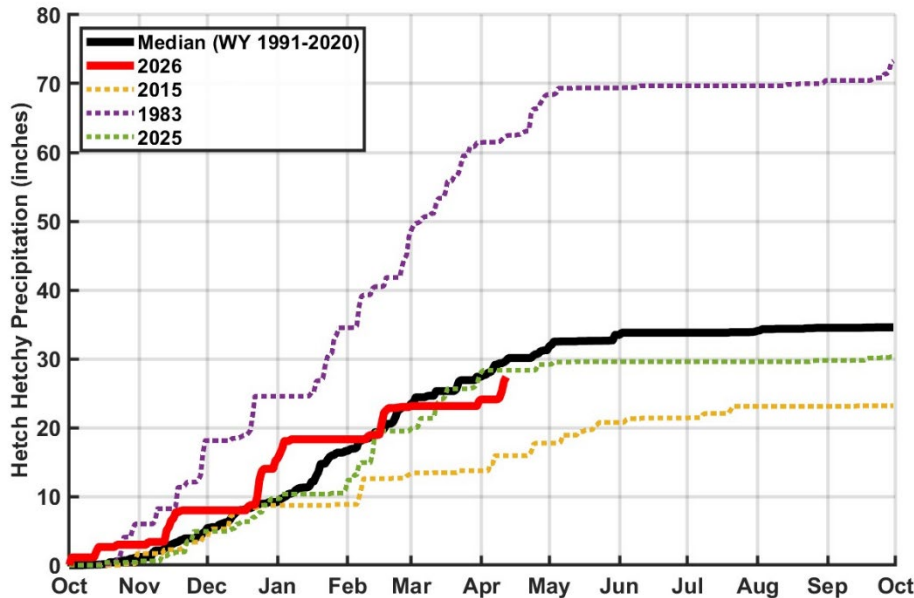


- Daniel Lurie**  
Mayor
- Joshua Arce**  
President
- Stephen E. Leveroni**  
Vice President
- Avni Jamdar**  
Commissioner
- Kate H. Stacy**  
Commissioner
- Meghan Thurlow**  
Commissioner
- Dennis J. Herrera**  
General Manager

**OUR MISSION:** To provide our customers with high-quality, efficient and reliable water, power and sewer services in a manner that values environmental and community interests and sustains the resources entrusted to our care.



## Upcountry Snowpack as of April 13, 2026

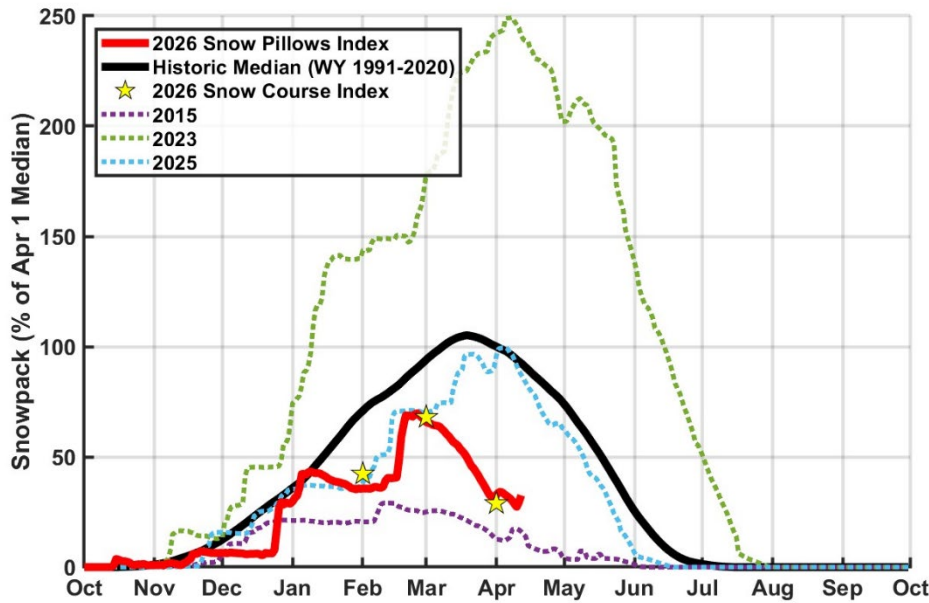

Peak snowmelt runoff could still occur in the remaining runoff season, but it may have already occurred during the middle of March, nearly two months earlier than the median peak snowmelt runoff date. Despite these historic conditions, we expect to fill the entire water system by the end of May 2026. Water Bank is currently full, supporting water deliveries throughout the year.

Reservoir storages as of April 13, 2026 are well above where they typically are this time of year.

Reservoir	Current Storage <sup>1,2,3</sup> (AF)	Maximum Storage <sup>4</sup> (AF)	Available Capacity (AF)	Percent of Maximum Storage	Percent of Maximum Storage <sup>5</sup>
<u>Tuolumne System</u>					
Hetch Hetchy	344,200	360,360	16,160	95.5%	<b>60.5%</b>
Cherry	262,900	273,345	10,445	96.2%	-
Eleanor	26,100	27,100	1,000	96.3%	-
Water Bank	570,000	570,000	0	100.0%	<b>99.5%</b>
<b>Total Tuolumne Storage</b>	<b>1,203,200</b>	<b>1,230,805</b>	<b>27,605</b>	<b>97.8%</b>	-
<u>Local System</u>					
Calaveras	62,036	96,670	34,634	64.2%	-
San Antonio	44,581	53,266	8,685	83.7%	-
Crystal Springs	46,584	68,953	22,369	67.6%	-
San Andreas	15,942	18,675	2,733	85.4%	-
Pilarcitos	1,945	3,125	1,180	62.2%	-
<b>Total Local Storage</b>	<b>171,088</b>	<b>240,689</b>	<b>69,601</b>	<b>71.1%</b>	-
<b>Total System Storage</b>	<b>1,374,288</b>	<b>1,471,494</b>	<b>97,206</b>	<b>93.4%</b>	<b>79.8%</b>
<b>Total without water bank</b>	<b>804,288</b>	<b>901,494</b>	<b>97,206</b>	<b>89.2%</b>	-

Though we continue to be in a solid position for water supply this year, as always, we appreciate the continued efforts of our customers to encourage water conservation in their service areas.

cc: Tom Smegal, CEO/General Manager, BAWSCA